



RESULTS SUMMARY REPORT [HIG713/12]

Test owner: Anicolor – Alumínios, Lda.

Date: 19/11/2012

Address: Zona Industrial de Oiã, Apartado 6, Oiã, 3770-059 Oiã

Contact name: José António Pinto


Tel.: +351 234 897 780

E-mail: tecnico@anicolor.pt

Tested specimen:

It was submitted for testing a specimen with the internal reference HIG521A/12, which had the following customer reference:

KRISTAL system – sliding minimalist with thermal break

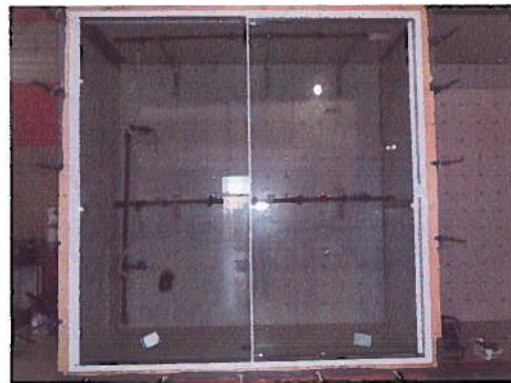

Specimen's photography

The specimen consisted of an aluminum window with two sliding sashes. Its dimensions were of 2840 mm x 2840 mm. The used glazing consisted in a double glazing system with a Clear float (8 mm) + Air gap (16 mm) with a Warm Edge spacer + Clear float (8 mm).

Performed tests and results:

The tests performed to the HIG521A/12 specimen and its results were the following:

Test	Classification
Determination of the air permeability (EN 1026:2000)	CLASS 3
Determination of the watertightness (EN 1027:200)	CLASS 6A
Determination of the wind load resistance (EN 12211:2000)	CLASS C2

This document contains results listed in the test report no. HIG710/12, of 19/11/2012.

For a proper authentication and interpretation of the obtained results it is essential to consult the referred documentation.

Report author: José António Pinto

Technical supervisor: Nuno Simões
(Technical and Scientific Supervisor)

Administration:



This report may not be reproduced, except if complete, without the written consent of ITeCons.

HIG713/12